




Type 1+2 AC surge protector - 1-pole

CITEL

DS250VG-400



- ↳ Type 1+2+3 unipolar surge protector
- ↳ 25 kA on 10/350µs impulse
- ↳ Low voltage Up
- ↳ Internal disconnection, status indicator and remote signaling
- ↳ Optimized to TOV
- ↳ IEC 61643-11 and UL1449 ed.5 compliance

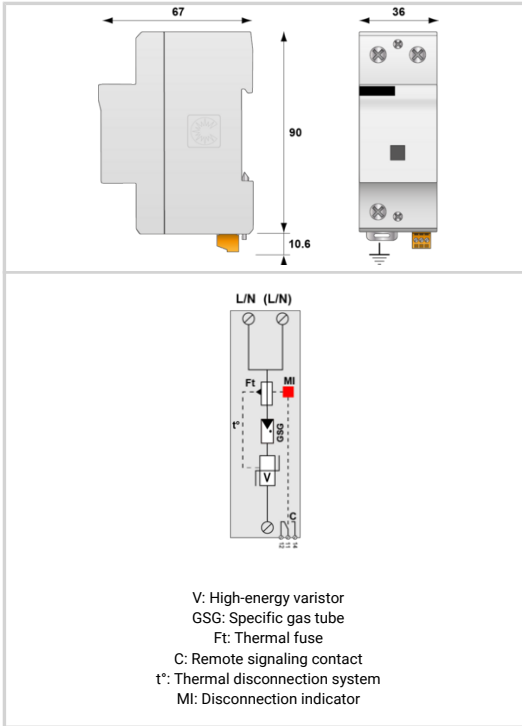

Electrical Characteristics		
SPD type		1+2+3
Network		230/400 V
Nominal line voltage	Un	400 Vac
Max. AC operating voltage	Uc	440 Vac
Max. load current if series connection	IL	100 A
Temporary Over Voltage (TOV) Characteristics - 5 sec. Without disconnection	UT	580 Vac withstand
Temporary Over Voltage (TOV) Characteristics - 120 mn Without disconnection or with safety disconnection	UT	770 Vac withstand
Residual Current Leakage current to Ground	Ipe	None
Follow current	If	None
Nominal discharge current 15 x 8/20 µs impulses	In	30 kA
Max. discharge current max. withstand @ 8/20 µs by pole	I _{max}	70 kA
Impulse current by pole max. withstand 10/350µs by pole	I _{imp}	25 kA
Withstand on Combination waveform IEC 61643-11 Class III test: 1.2/50µs - 8/20µs	Uoc	20 kV
Withstand on overvoltages IEEE C62.41.1		20 kV
Specific energy by pole max. withstand 10/350 µs	W/R	156 kJ/ohm
Connection mode(s)		L/N or L/PE
Protection mode(s)		Common Mode or Differential Mode
Protection level @ In (8/20µs) and @ 6 kV (1,2/50 µs)	Up	1.5 kV
Residual voltage @ In (8/20 µs)	Up-in	1.1 kV
Residual voltage at 5 kA @ 5 kA (8/20µs)	Up-5kA	1 kV
Admissible short-circuit current	I _{sc}	50 000 A
Mechanical Characteristics		
Technology		VG Technology (MOV+GSG)
SPD configuration		Single phase
Connection to Network		By screw terminals: 6-35mm ² / by bus
Format		1-pole modular box
Mounting		Symmetrical rail 35 mm (EN 60715)
Housing material		Thermoplastic UL94 V-0
Operating temperature	Tu	-40/+85°C
Protection rating		IP20
Failsafe mode		Disconnection from AC network
Disconnection indicator		1 mechanical indicator
Remote signaling of disconnection		Output on changeover contact
Dimensions		See diagram
Weight		0.303 kg
Disconnectors		
Thermal disconnector		Internal
Installation ground fault breaker		Type 'S' or delayed
Back-up protection device		Fuses type gG - 315 A
Standards		
Standards compliance		IEC 61643-11 / EN 61643-11 / UL1449 ed.5
Certification		
Part number		
2578		

